



AI-7011/7021 DUAL TEMPERATURE TRANSMITTER / SIGNAL ISOLATOR

Operation Instruction



1.SUMMARY

AI-7011/7021 D5 acts as 1~2 channel transmitter or signal isolator.

- It provides 1~2 channels of programmable inputs, supporting multiple voltage, RTD, thermocouple inputs with auto reference junction compensation. If parallel connected to an external precise resistance, it accepts current signal input. Each channel has independent digital filter and can adjust its filtering degree.
- It generates 1~2 isolated current outputs, 4~20mA or 0~20mA. The range of retransmission output can be freely defined.
- This model uses high performance hardware, which leads to greatly decreased temperature drift and interference among the two channels. As a result, this instrument achieves the same measurement accuracy and anti-interference ability as that of single channel instrument.
- It generates digital adjusted current output without potentiometer, making the current output precise and stable.
- The model is DIN rail mounted. Its width is only 22.5mm. The instrument can be easily configured by connecting to our E8 external display.
- Universal power supply of 100-240VAC or 24VDC.
- ISO9001 and CE certified and meets EMC standards. Its power and all I/O terminals pass 4KV/5KHz EFT test and can work reliably under interference.

2.TECHNICAL SPECIFICATION

● Input type:

Thermocouple: K, S, R, E, J, T, B, N, WRe5-WRe26
RTD:Pt100, Cu50

Linear voltage: 0~20mV, 0~60mV, 0~100mV, 0~1V, 0.2~1V etc.

● Instrument Input range

K(-50~+1300℃), S(-50~+1700℃), R(-50~+1700℃),
T(-200~+350℃), E(0~1000℃), J(0~1200℃),
B(0~1800℃), N(-50~+1300℃), WRe5-WRe26(0~2300℃),
Pt100(-200~+900℃), Cu(-50~+150℃)
Linear Input: -9990~+30000 units defined by user.

- **Retransmission accuracy** : 0.3%FS ± 1 digit (including input and output error)
- **Output Specification**: can be freely defined in the range of 0~22mA with maximum output voltage ≥ 11V
- **Temperature drift** : ≤ 0.015%FS /℃ (including the temperature drift of input and output)
- **Electromagnetic compatibility (EMC)** : ±4KV/5KHz according to IEC61000-4-4 (EFT); 4KV according to IEC61000-4-5.
- **Isolation withstanding voltage** : voltage between power, signal input and output terminals ≥ 2300VDC; between inputs or 2 outputs ≥ 200VDC
- **Power supply** :
100~240VAC, -15%, +10% / 50Hz; or 24VDC/AC.
- **Power consumption**: ≤ 3W
- **Operating Ambient** : Temperature -10~+60℃ ;
humidity ≤ 90%RH

Note1: B thermocouple obtains the above measurement accuracy only at the range of 400~1800 ℃ . Its measurement from 60~400℃ . is less accurate.

3.LAYOUT OF TERMINALS AND INDICATION LIGHTS AND WIRING

Layout of AI-7011/7021D5 indication lights and terminals is illustrated below:

Terminal 1 and 2 are for power supply of 100-240VAC or 24VAC/DC.
Terminal 5 and 6 are the positive and negative pole of channel 1 current retransmission output.

Terminal 7 and 8 are the positive and negative pole of channel 2 current retransmission output.

Terminal 14~16 are for channel 1 input.


Terminal 10~12 are for channel 2 input.(for AI-7021 only)

Indication light OP1~OP2: indicate the outputs of channel 1 and 2. The luminosity of the light indicates the magnitude of the output.

Indication light--- MODE:

When the light flickers even faster, at a rate of once every 0.3 second, it indicates severe errors such as input exceeding its acceptable range.

When the light is off, it indicates that the instrument has no power or it is out of order. When the light is on (for at least longer than 8 seconds), it indicates that the instrument has power on but is out of order.

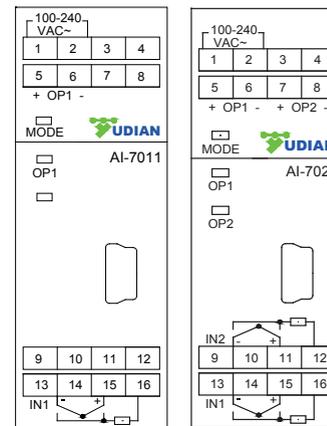

4.DISPLAYS AND OPERATIONS

The parameters of AI-7011/7021D5 can be set by an external E8 display which can be used to configure AI-7011/7021D5 at the initial set up, as well as remain connected to AI-7011/7021D5 and serves as an external display.



The functions of the parts of E8 external display panel is as below:

- ① Upper display window, displays PV of channel 1 or parameter code, etc. when display keep flashing or the reading abnormal, please check the input specification set correct or not.
- ② Lower display window, displays PV of channel 2 or parameter value. When display keep flashing or the reading abnormal, please check the input specification set correct or not.
- ③ Setup key, for accessing parameter table and conforming parameter modification.
- ④ Data shift key.
- ⑤ Data decrease key
- ⑥ Data increase key.

Note: The 1394 socket of the instrument only supports Yudian E8 display.

Operation Instructions:

Setting parameters:

When the parameter lock "Loc" isn't locked, pressing and holding for about 2 seconds will bring up the full parameter table. Pressing will bring up the parameters one by one. Press , or to modify the value of a parameter. Pressing and holding will return to the preceding parameter. Pressing and holding and at the same time press key will get out of the parameter table.

When the parameter lock "Loc" is locked, pressing will bring up field parameter table which just shown INPx, SCLx and SCHx from display and can't modify.

The instrument will automatically leave the parameter table if no key is pressed in the past 25 seconds, and the change of the last parameter will not be saved.

5.SETTING PARAMETERS

x means channel number. It can be 1~2.

Parameter	Name	Remarks	Setting range	
INPx	Input specification	Define the input specification of channel 1~2.	0 ~ 32	
		INP		Input spec.
		0		K
		1		S
		2		R
		3		T
		4		E
		5		J
		6		B
		7		N
		8		WRe3-WRe25
		9		WRe5-WRe26
		10		Extended input spec.
		11~19		Spare
		20		Cu50
		21		Pt100
		22~24		Spare
25	0~75mV			
26~27	Spare			
28	0~20mV voltage			
29	0~100mV			
30	0~60mV voltage			
31	0~1V			
32	0.2~1V			
SCLx	Scale low limit	SCL and SCH define the corresponding scale range of linear output. For example, for channel 1, in order to retransmit 0~600°C to output channel 1, SCL1 = 0, and = 600.	-999~+3000 units	
SCHx	Scale high limit	For channel 2, to transmit 0~1000°C, then SCL2=0, SCH2=1000.		

Scbx	Input offset	Scb is used to shift input to compensate the error caused by transducer, input signal, or auto cold junction compensation of thermocouple. PV_{after compensation}=PV_{before compensation} + Scb For thermocouple or three-wire RTD inputs, the units of Sc is 0.1°C. For example, when Scb= -100, the actual offset= -10°C, then the measured temperature will be 10°C lower than that when Scb=0.	-199~+999.0 units or 0.1°C
FILx	Digital filter	The value of FIL will determine the ability of filtering noise. FIL=0, no filtering; FIL=1, filtering with mean; FIL=2~40, filtering with mean and integral. When a large value is set, the measurement input is stabilized but the response speed is slow. Generally, it can be set to 1 to 3. If great interference exists, then you can increase parameter FIL gradually to make momentary fluctuation of measured value less than 2 to 5. When the instrument is being metrological verified, FIL can be set to 0 or 1 to shorten the response time.	0~40
OPn (For 7021 only)	Retransmission channel assignment	OPn=1, Normal retransmission. OP1 outputs IN1 while OP2 outputs IN2. OPn=2, Enable splitter mode. Single input from IN2 dual output.	0~6
OPL	Low limit of current retransmission of Channel 1	Define the low limit and high limit of current retransmission at OUTP position. The engineering unit is 0.1mA.	0~110
OPH	High limit of current retransmission of Channel 1	For example, to retransmit 0~600°C in input channel 1 to 4~20mA, then the parameter should be set as below: SCL1=0, SCH1=600, OPn=1, OPL=40, OPH=200.	0~220

OPL2	Low limit of current retransmission of Channel 2	Define the low limit and high limit of current retransmission of channel 2. The engineering unit is 0.1mA.	0~100
OPH2	High limit of current retransmission of Channel 2	For example, to retransmit 0~1000°C in input channel 2 to 4~20mA, then the parameter should be set as below: SCL1=0, SCH1=1000, OPn=1, OPL=40, OPH=200.	0~220
IVF1	OP1 current correction (Please record the value when first use)	For adjusting the current of OP1 output. The greater IVF1, the greater current output. Note: This parameter was adjusted before delivery. It is better not to change this value by yourself.	0~3000 Default=()
IVF2	OP2 current correction (Please record the value when first use)	For adjusting the current of OP2 output. The greater IVF1, the greater current output. Note: This parameter was adjusted before delivery. It is better not to change this value by yourself.	0~3000 Default=()
Loc	Parameter Lock	Loc=808, allow to display and modify all parameters. Otherwise, all parameters can't be modify and which just shown INPx, SCLx and SCHx from display	0 ~9999

6.SYMBOL DESCRIPTIONS

Symbol	Description
orAL	Input specification setting is incorrect Or Input wiring is disconnected/ thermocouple problem Or Short circuited
EErr	IC Software error
8888	IC Software error